


GOLDENROD[®]

NO. 597 BiO-FLO[®] FUEL TANK FILTER

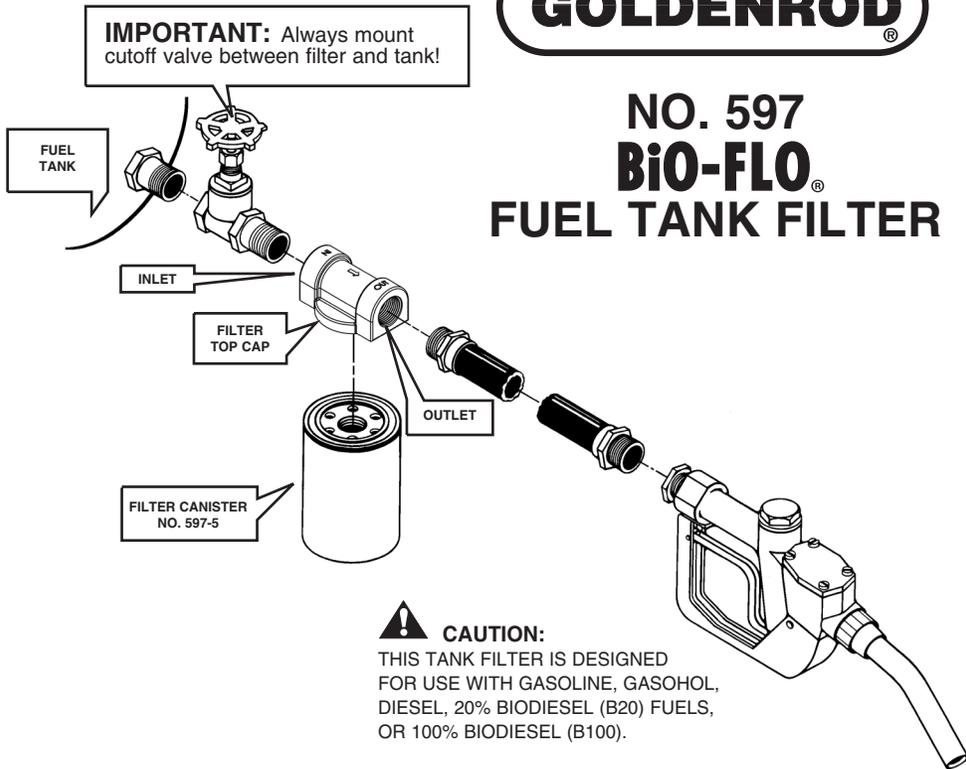

INSTALLATION INSTRUCTIONS

Attach filter top cap to storage tank valve on opening marked "IN". Be sure there is a shut-off valve between filter and tank. Attach hose and nozzle to filter opening marked "OUT". **CAUTION:** Do not tighten filter cap using the element for leverage.

When installing the element, apply a coating of oil to the rubber gasket. Element should be hand tightened only. Over tightening of the element will result in difficulty in removal at a later date. When assembly is complete, check for leaks.

Change filter on a semi-annual basis or when flow is restricted.

NOTE: This filter is rated for 50 psi pressure. If the fuel system is prone to violent pressure surges (water hammers, etc.), a pressure cushion device should be installed. A vertical capped pipe installed in the line near the filter so that it traps a pocket of air will serve this function. This is not necessary unless pressure surges above 50 psi occur.

1886

DUTTON-LAINSON COMPANY

Hastings, NE 68902 U.S.A. • Tel 402-462-4141 • Fax 402-460-4612
dlsales@dutton-lainson.com • www.dutton-lainson.com

ISO 9001 Certified Q.M.S.



Drawing No.
202772A 8/19



Manufactured in the

